

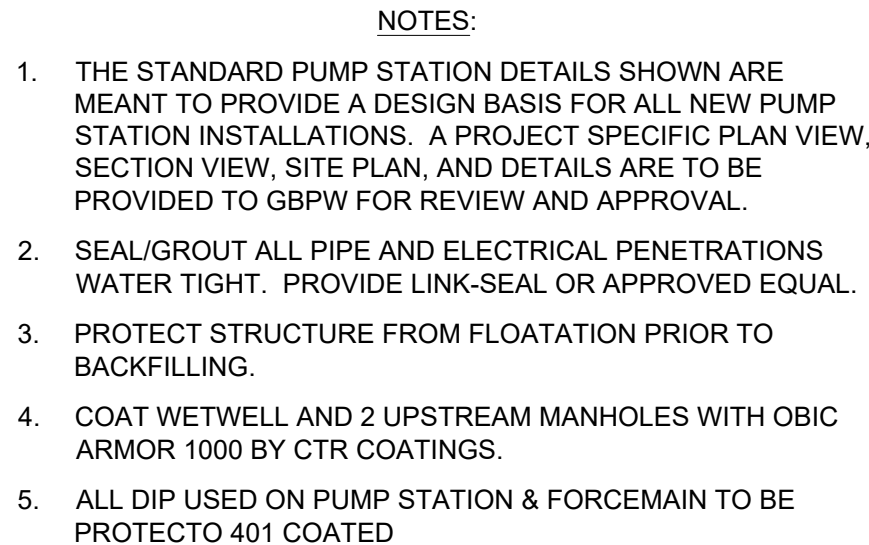


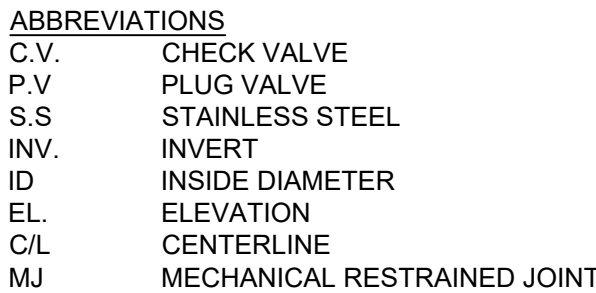

DATE	REVISIONS & RECORDS OF ISSUE	BY	CH	AP	DRAWN	A. HARRIS		GAFFNEY BOARD OF PUBLIC WORKS	SEAL	PROJECT NAME STANDARD DETAILS LIFT STATION	PROJECT NO.	SHEET NO.
					CHECKED			GAFFNEY, SC 29340				
					APPROVED			864-488-8800				
					DATE	3-25-25						

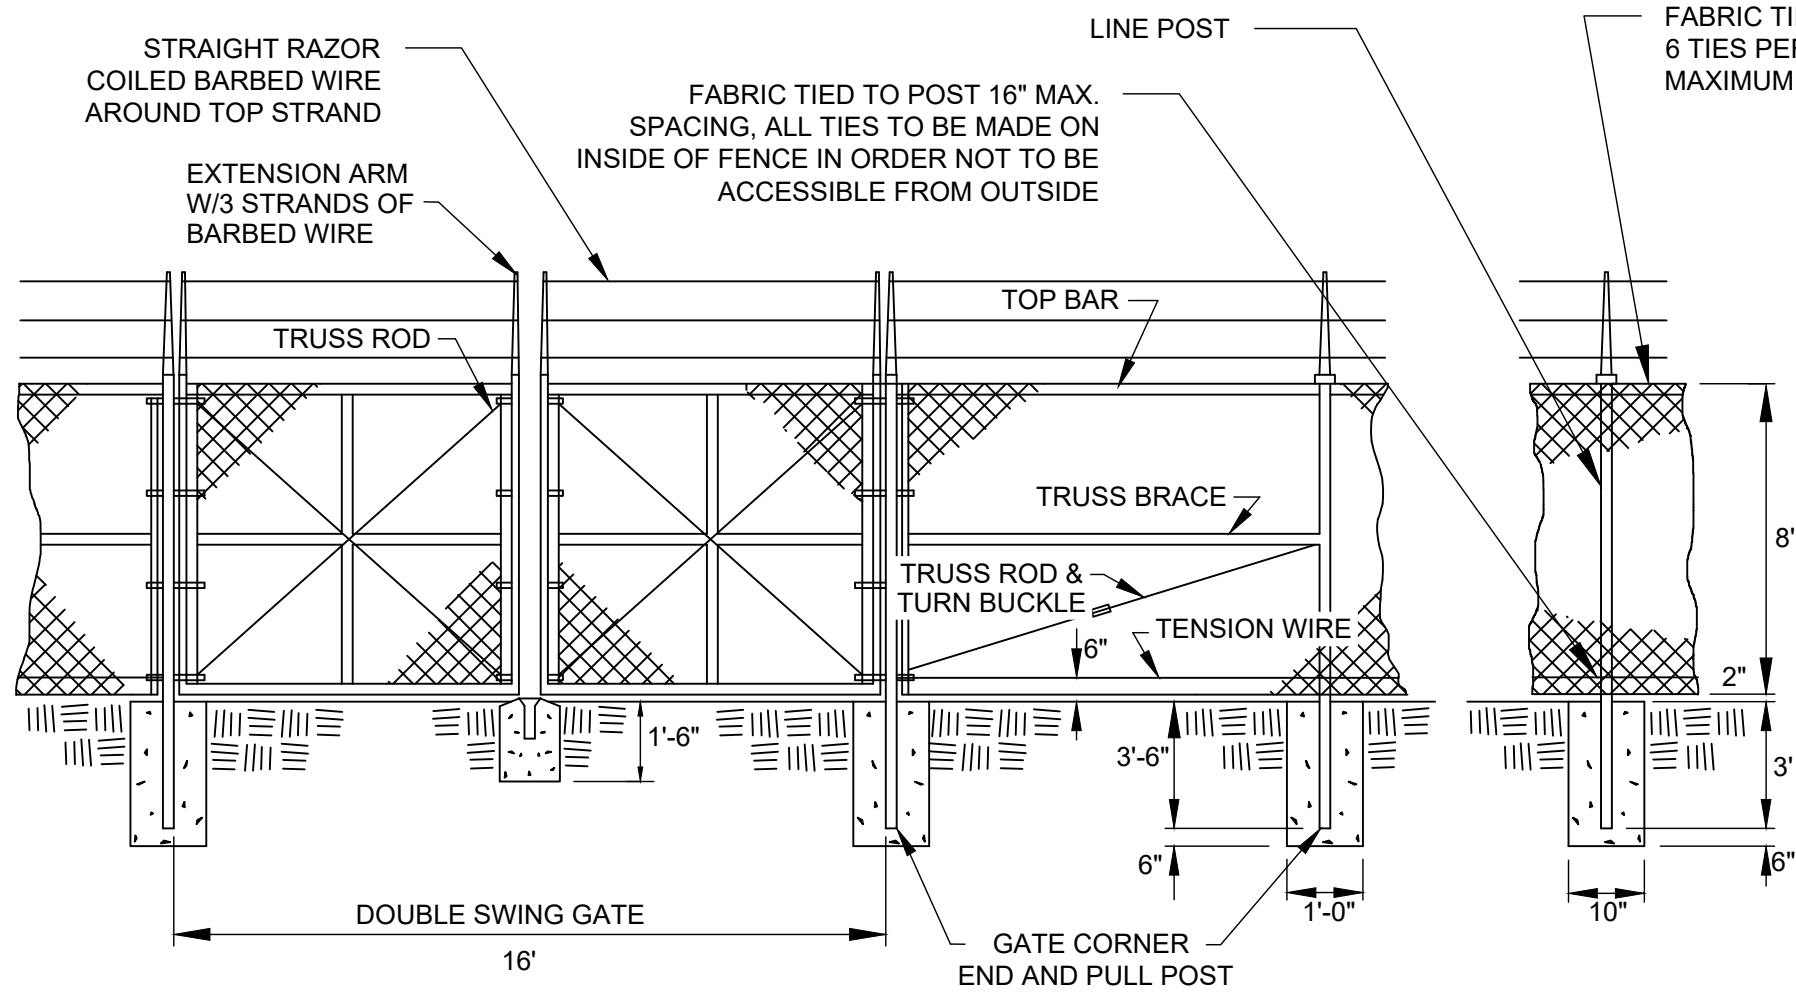


NOTES:

1. PROVIDE FINISH GALVANIZED TO ASTM A123/A123M FOR COMPONENTS; ASTM A153/A153M FOR HARDWARE; ASTM A392 FOR FABRIC; 1.8 OZ/SQ FT COATING.
2. FABRICATE GATES TO PERMIT A 180° SWING. FINISH IS TO BE GALVANIZED TO MATCH FENCE.
3. MATERIALS:
 - FRAMING (STEEL): ASTM F1083 SCHEDULE 40 GALVANIZED STEEL PIPE, WELDED CONSTRUCTION, MINIMUM YIELD STRENGTH OF 50 KSI; COATING CONFORMING TO ASTM F1043 TYPE A ON PIPE EXTERIOR AND INTERIOR.
 - FABRIC WIRE (STEEL): ASTM A392 CLASS 1 ZINC COATED STEEL WIRE.
 - BARBED WIRE: ASTM A121 COATING TYPE Z, GALVANIZED STEEL; 12 GAGE THICK WIRE, 2 STRANDS, 4 POINTS AT 3 INCH ON CENTER.
 - CONCRETE: CLASS 2500 CONCRETE IN ACCORDANCE WITH SCDOT STANDARD SPECIFICATIONS WITH 2500 PSI COMPRESSIVE STRENGTH AT 28 DAYS.
4. COMPONENTS:
 - LINE POSTS: 2.5 INCH DIAMETER
 - CORNER AND TERMINAL POSTS: 2.875 INCH
 - GATE POSTS: 4.0 INCH DIAMETER
 - TOP AND BRACE RAIL: 1.625 INCH DIAMETER, PLAIN END, SLEEVE COUPLED
 - GATE FRAME: 1.925 INCH DIAMETER FOR WELDED FABRICATION
 - TENSION WIRE: 6 GAGE THICK STEEL, SINGLE STRAND
 - TENSION BRAND: 3/16 INCH THICK BY 3/4 INCH WIDE STEEL
 - TIE WIRE: ALUMINUM ALLOY STEEL WIRE, 9-GAGE OR 11-GAGE AS INDICATED

TYPICAL CHAIN LINK FENCE W/ DOUBLE SWING GATE DETAIL

SCALE: NTS

DURING BYPASS OPERATION, CHECK VALVE AND FLANGE WITH CAM-LOCK TO BE INSTALLED HERE. AFTER BYPASS IS TERMINATED, REMOVE CHECK VALVE AND CAM-LOCK AND INSTALL BLANK FLANGE TAPPED WITH 2" FPT PLUG.

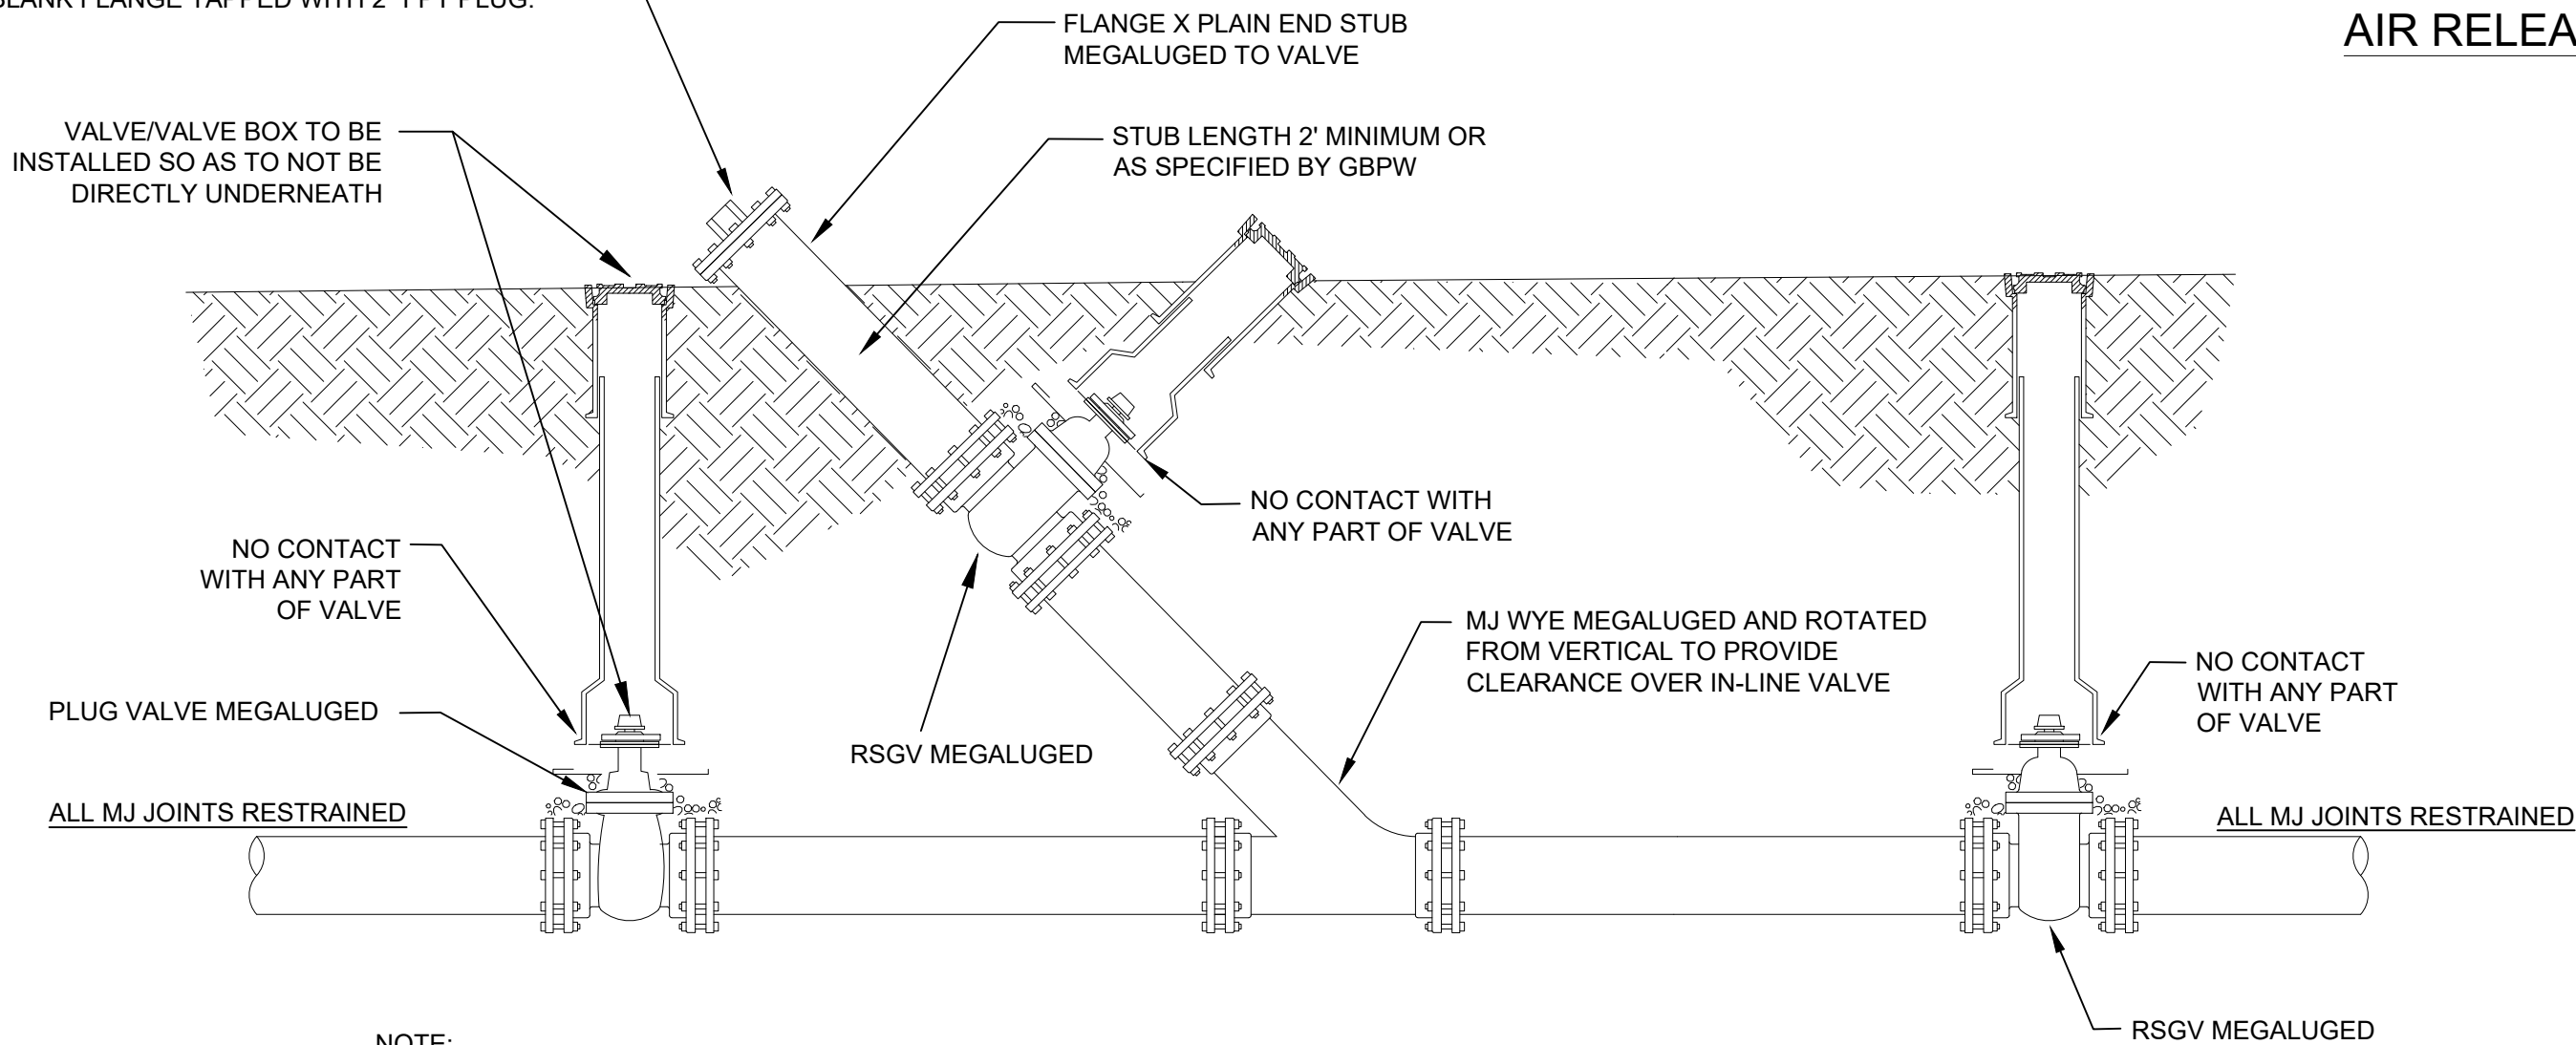


NOTE:

1. THIS ASSEMBLY WILL SERVE AS BOTH A PIG LAUNCHING STATION AND A BYPASS CONNECTION WHEN NEEDED. IF PROPERLY SIZED AND SERVICEABLE ITEMS ARE AVAILABLE, THE CONTRACTOR SHALL RESUSE ONE EXISTING, FLGxFLG, EXTERNAL WEIGHTED ARM CHECK VALVE AND THE FEMALE CAM-LOCK FITTING MATTED TO THE FLANGE AS SHOWN WHICH WILL BE INSTALLED ABOVE GROUND WHEN USED AS A BYPASS CONNECTION. IF CHECK VALVE OR CAM-LOCK ARE NOT AVAILABLE OR SERVICEABLE, THESE ITEMS ARE TO BE PROVIDED BY THE CONTRACTOR AS PART OF THE PROJECT.
2. WHEN THE BYPASS OPERATION IS TERMINATED, THE CONTRACTOR SHALL REMOVE THE CHECK VALVE AND CAM-LOCK FITTING WITH FLANGE AND FASTENERS, PROVIDE THESE PARTS TO GAFFNEY BOARD OF PUBLIC WORKS AND INSTALL TREADED FLANGE AND PLUG AS SHOWN.



TYPICAL PIG LAUNCHER/BYPASS CONNECTION DETAIL

SCALE: NTS

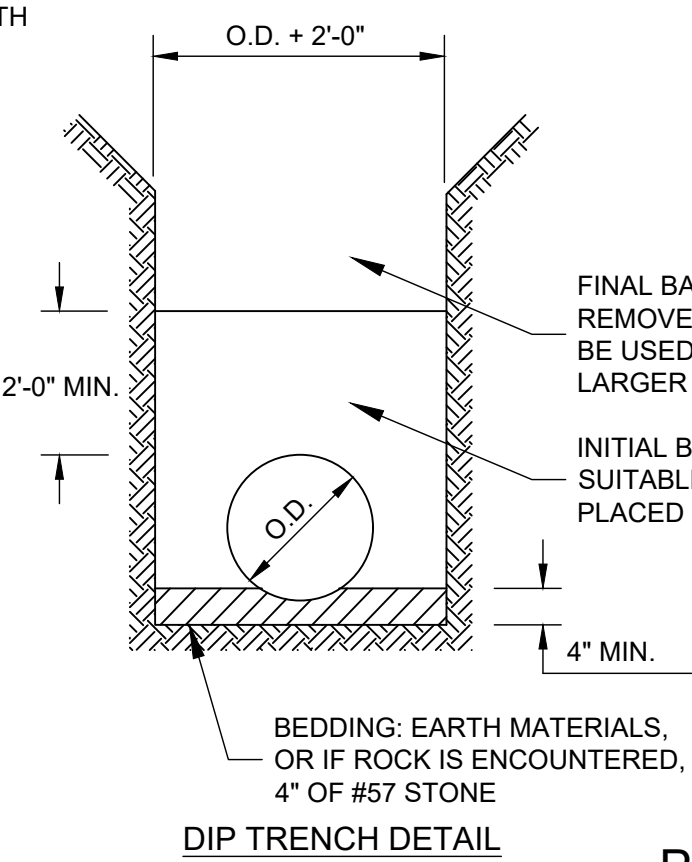


PIPE TRENCH DETAIL

SCALE: NTS

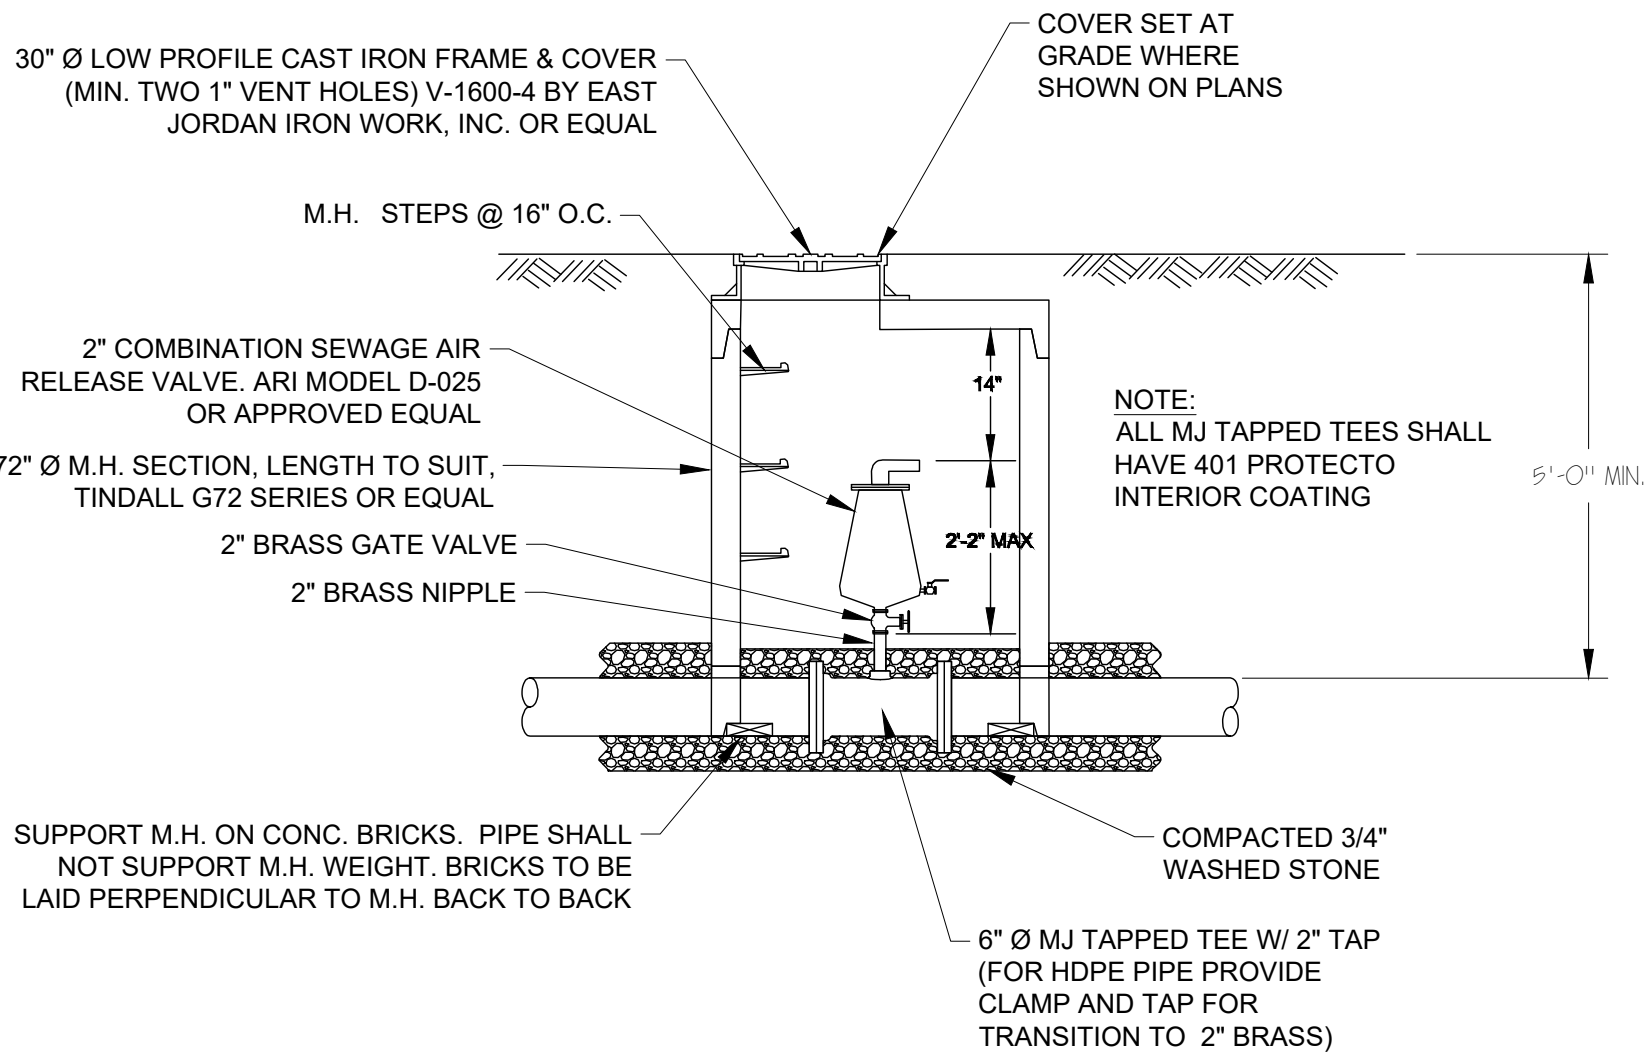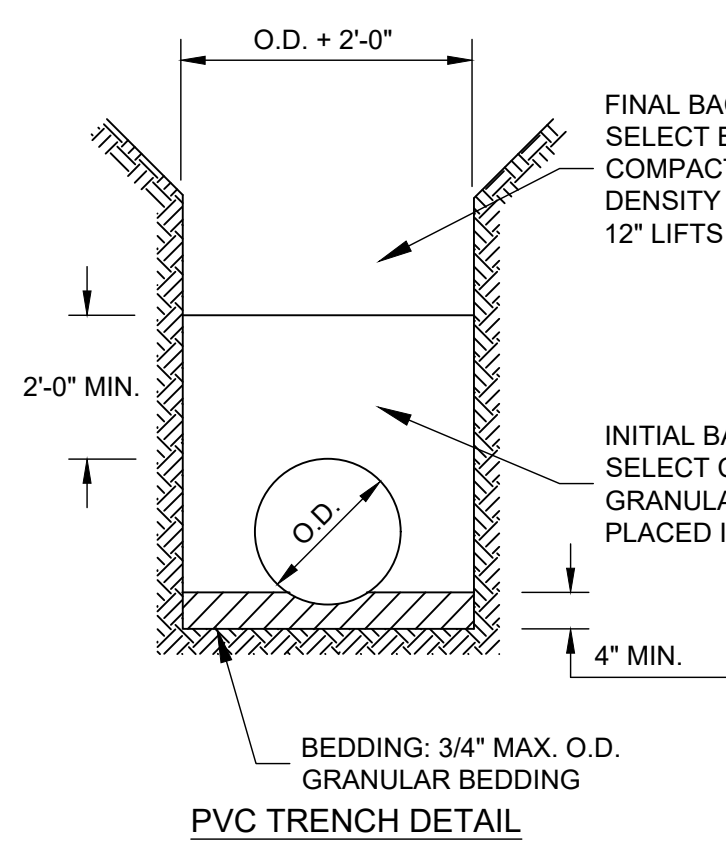

AIR RELEASE VALVE DETAIL

SCALE: NTS

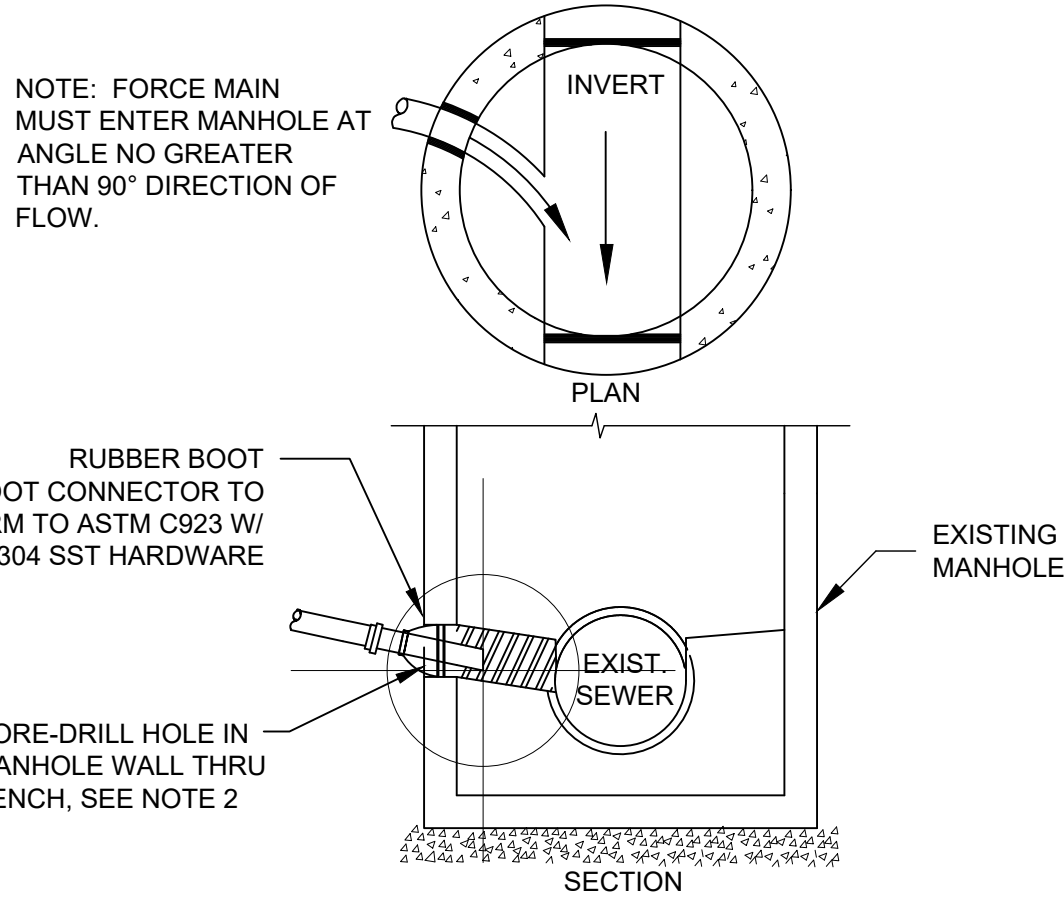


CORROSION CONTROL NOTES:

1. FORCEMAIN DISCHARGE MANHOLE AND NEXT DOWNSTREAM MANHOLE TO BE COATED WITH OBIC ARMOR 1000 BY CTR COATINGS.
2. CORE DRILL HOLE THROUGH WALL OF MANHOLE AND EXISTING BENCH AS DEPICTED IN THE DETAIL. PROVIDE A WATERTIGHT SEAL AT THE PIPE CONNECTION USING A FLEXIBLE RUBBER BOOT.

TYPICAL FORCE MAIN DISCHARGE TO EXISTING RECEIVING MANHOLE

SCALE: NTS

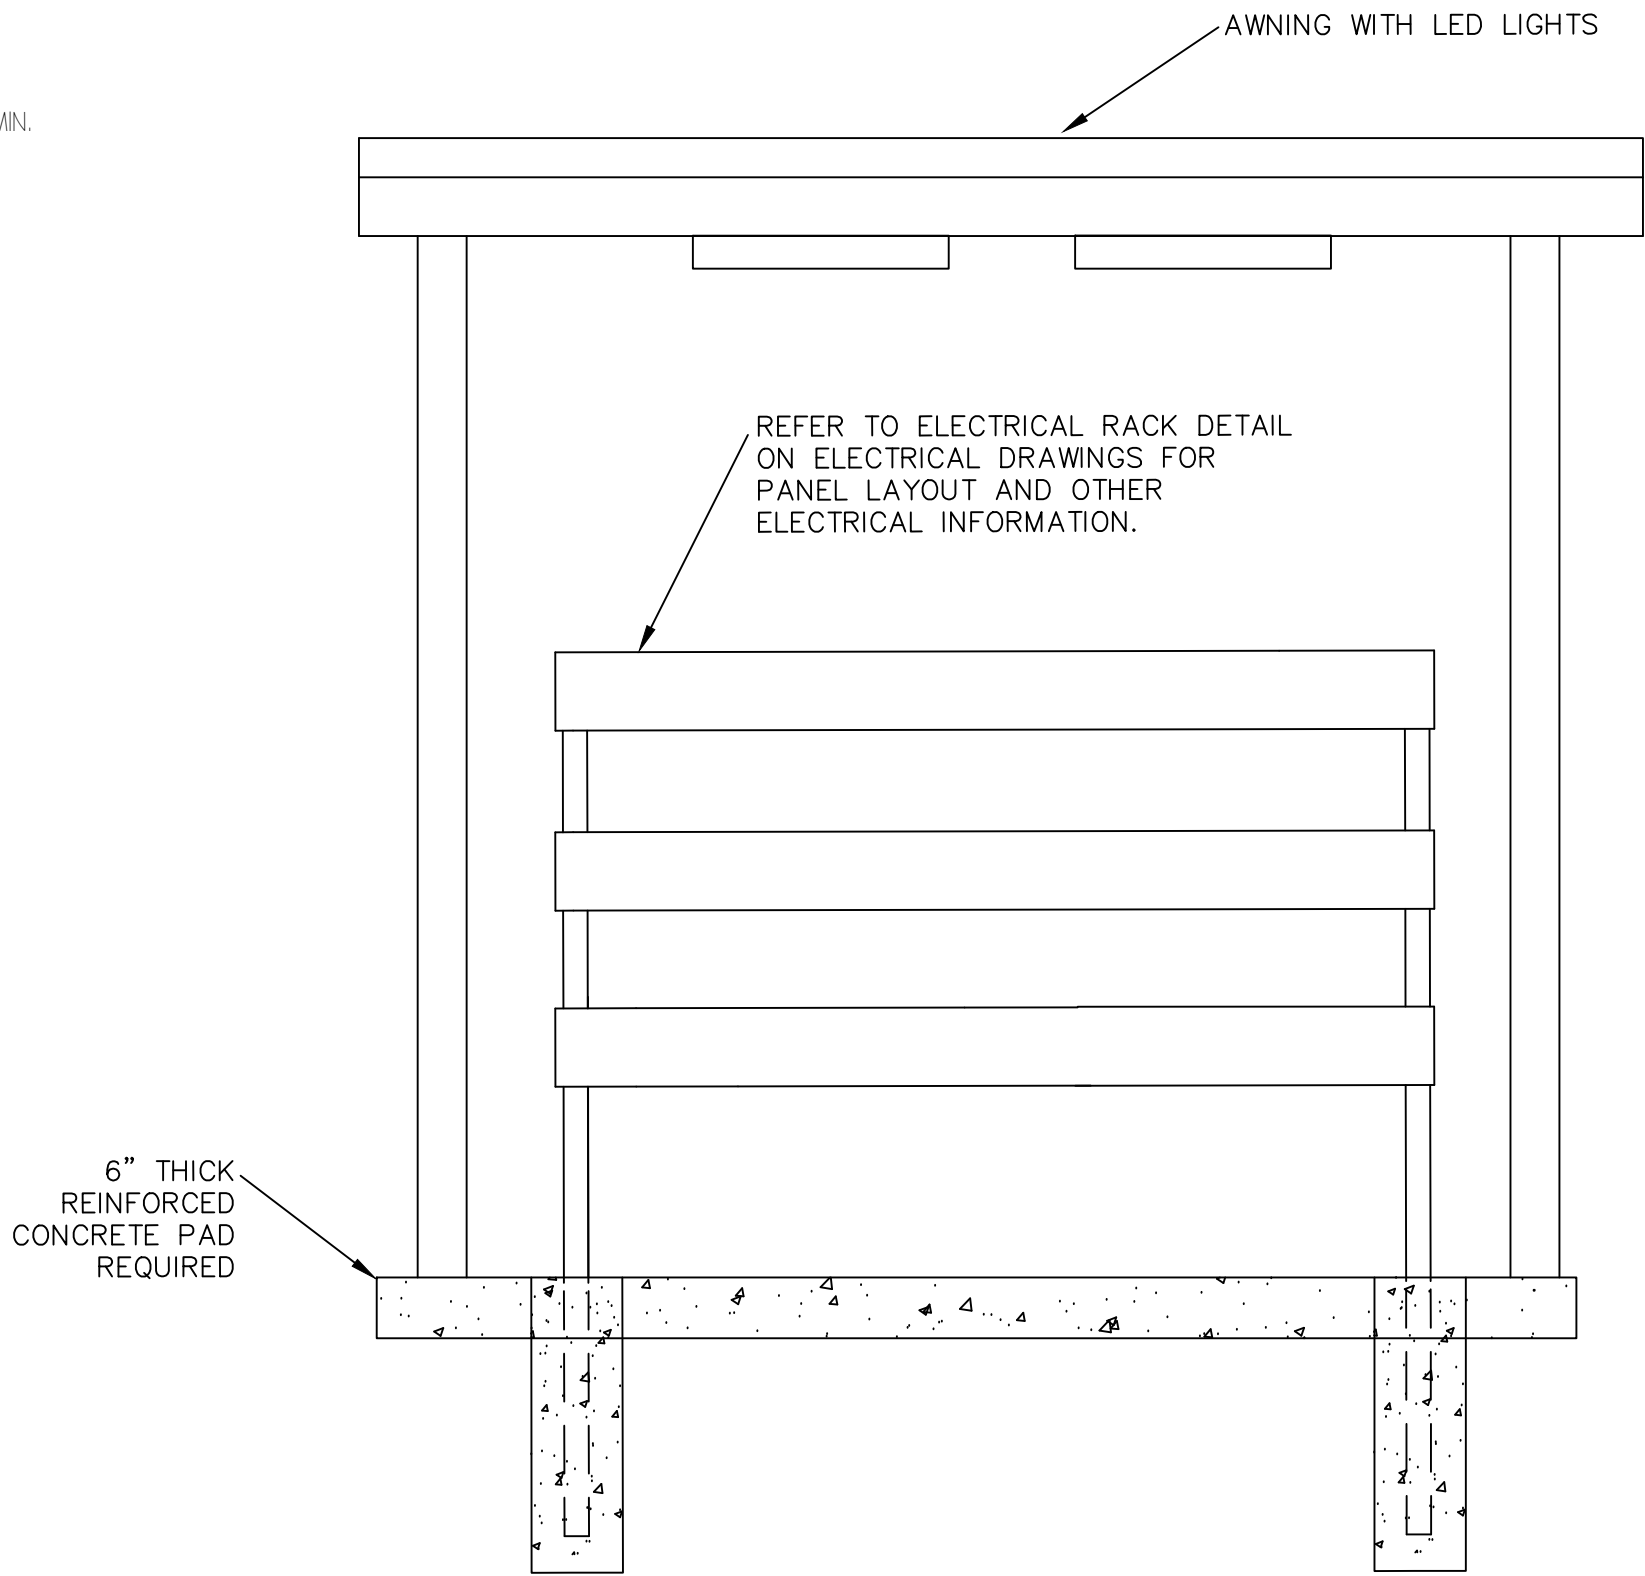



CONTROL CANOPY COVER SHALL BE BY GREENVILLE AWNING COMPANY, 864-288-0063, OR APPROVED EQUAL. THE CANOPY SHALL HAVE A PITCHED ROOF WITH 6' x 14' OUTSIDE DIMENSIONS, OR AS NEEDED TO MATCH SIZE OF ELECTRICAL PANEL RACK, AND 8' CLEAR HEIGHT. CANOPY TO BE CONSTRUCTED OF THE FOLLOWING MATERIALS:

- 1) 4" x 4" SUPPORT POSTS (11 GAUGE STEEL TUBING WITH WELDED STEEL PLATES ANCHORED TO CONCRETE PADS WITH 3/4" x 5" STUD ANCHORS).
- 2) 2"x2" SUPPORT BEAMS (14 GAUGE STEEL TUBING WITH WELDED UPRIGHTS).
- 3) 1-1/8" WIDE x 3-1/2" HIGH BOS RAFTERS (0.040 GAUGE ALUMINUM SHEET SPACED A MAXIMUM OF 2' ON CENTER).
- 4) 20 GAUGE STEP DOWN ALUMINUM SHEET ROOFING WITH 2" CORRUGATIONS & FASTENED TO RAFTERS WITH STAINLESS STEEL SCREWS. ALL STEEL MATERIALS SHALL BE PRIMED AND PAINTED WITH INDUSTRIAL GRADE ENAMEL PAINT.
- 5) ALL ALUMINUM MATERIALS SHALL HAVE INDUSTRIAL GRADE BAKED ENAMEL PAINT. CONTRACTOR SHALL SUBMIT COLOR CHARTS FOR OWNER SELECTION. CANOPY STRUCTURE SHALL BE DESIGNED FOR A MINIMUM 70 MPH WIND LOAD AND 25 LBS/SF.


ELECTRICAL CANOPY DETAIL

SCALE = N.T.S.

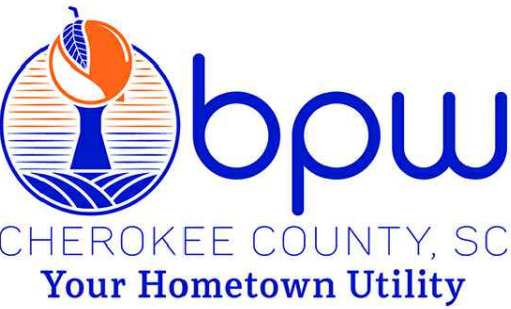
DATE	REVISIONS & RECORDS OF ISSUE	BY	CH	AP	DRAWN	A. HARRIS		GAFFNEY BOARD OF PUBLIC WORKS GAFFNEY, SC 29340 864-488-8800	SEAL	PROJECT NAME STANDARD DETAILS LIFT STATION	PROJECT NO. _____	SHEET NO. _____ OF ____
					CHECKED	_____						
					APPROVED	_____						
					DATE	3-25-25						

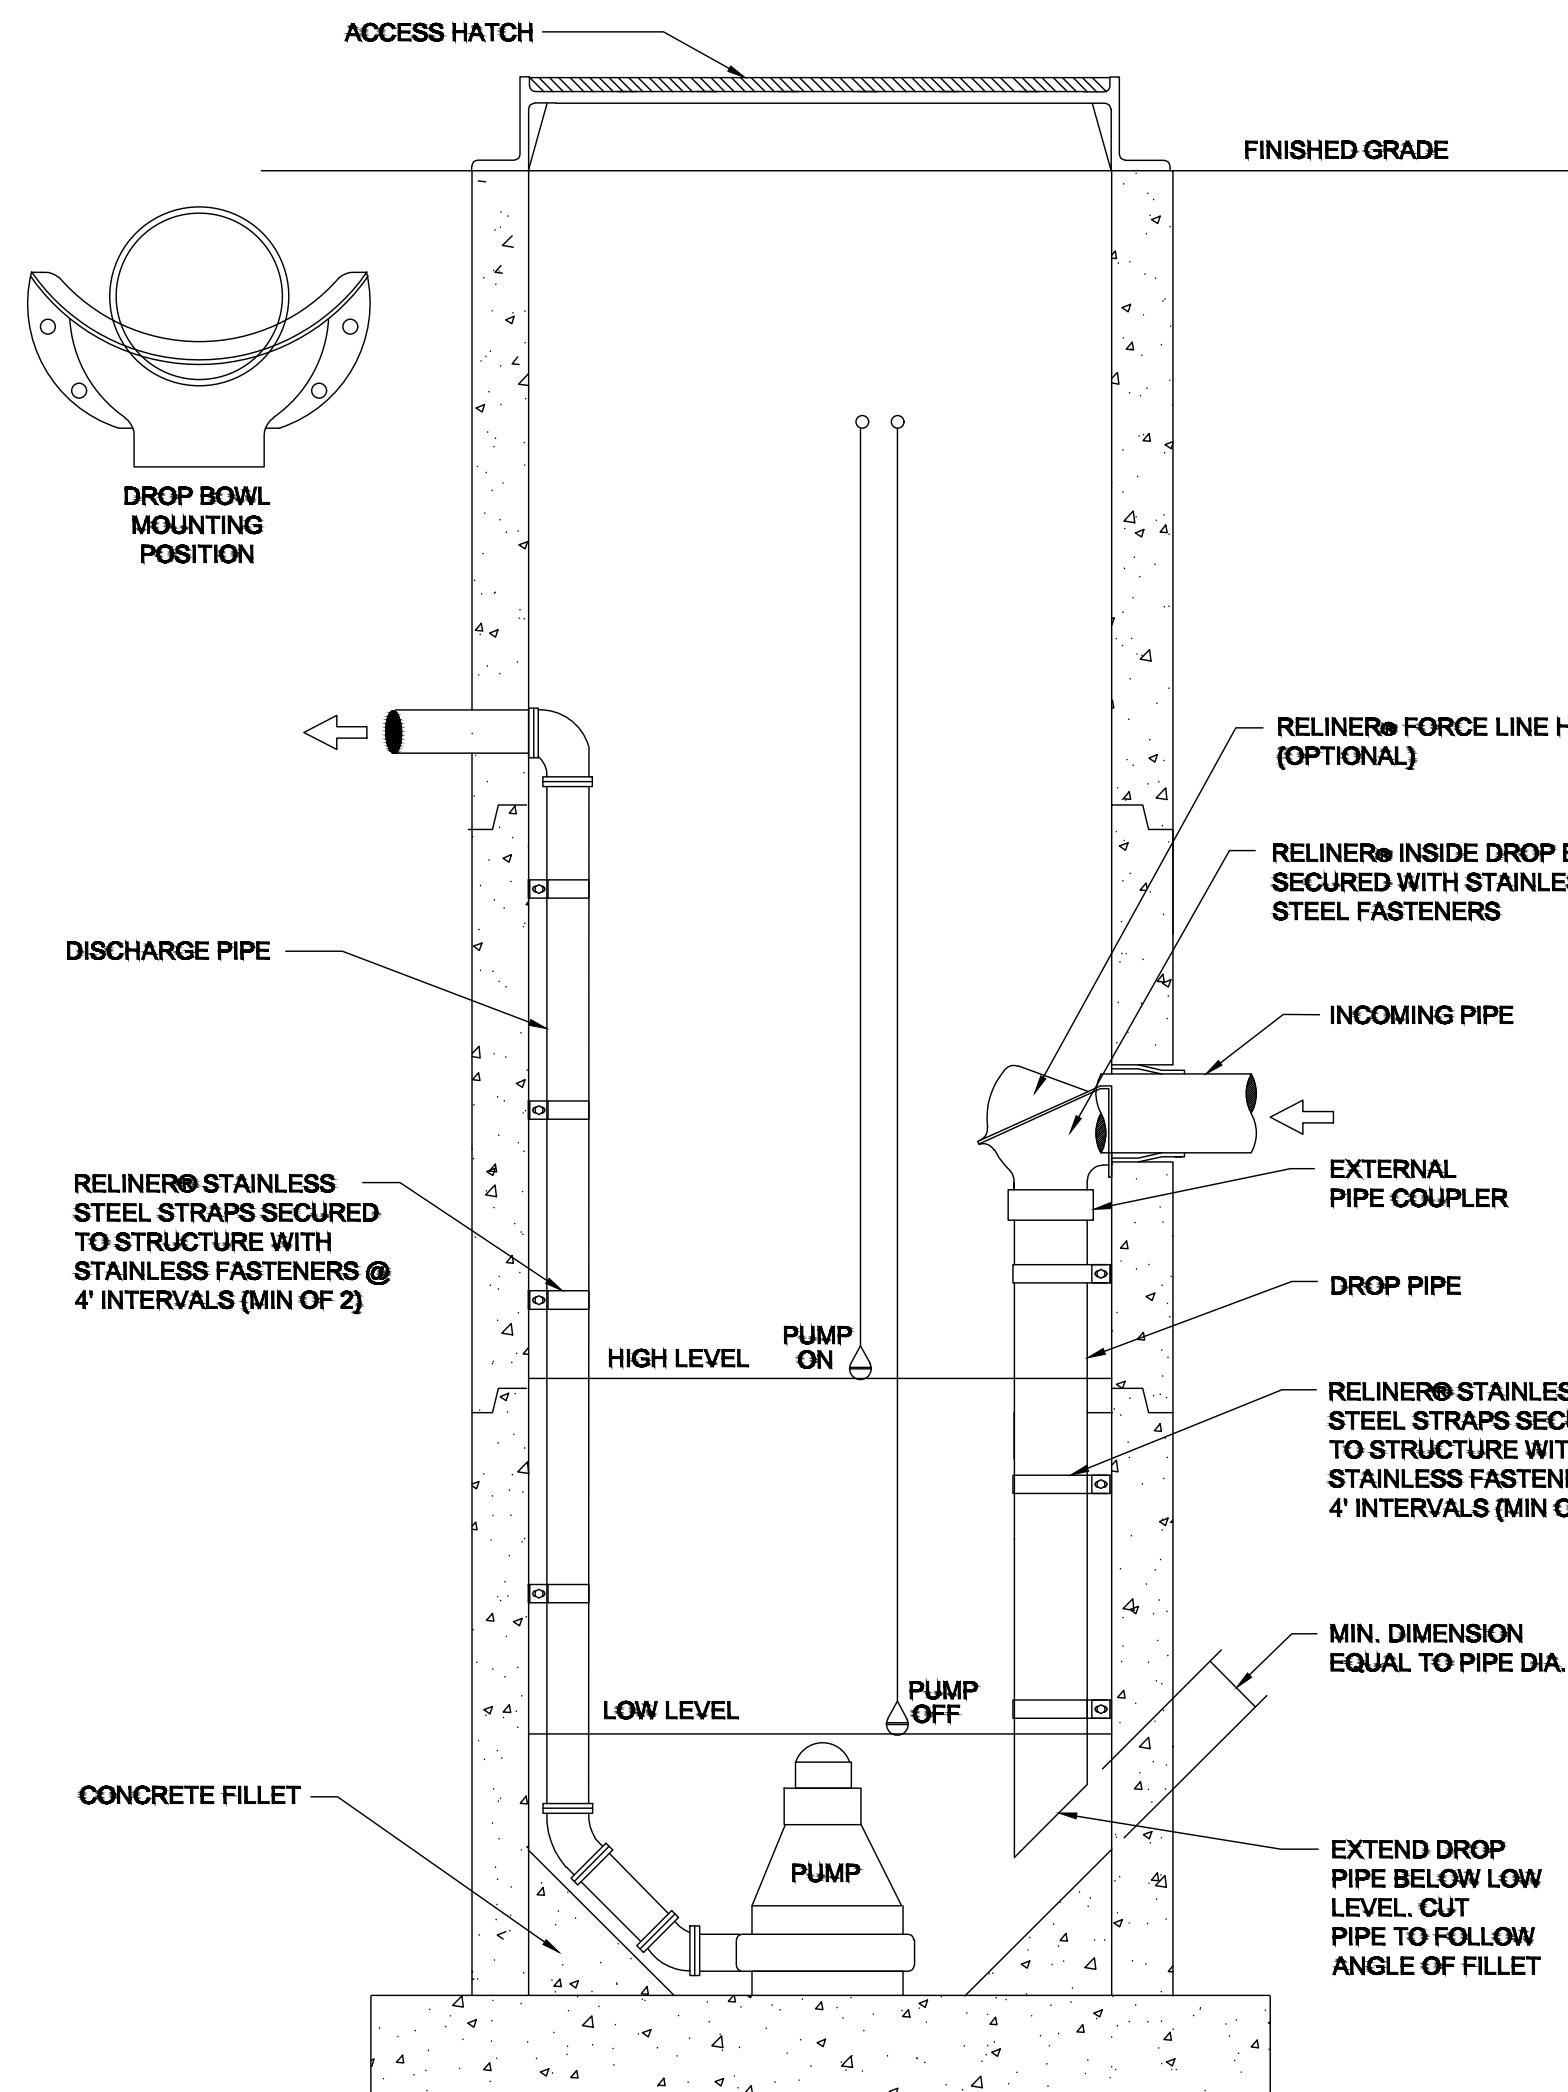


WETWELL INSIDE DROP DETAIL

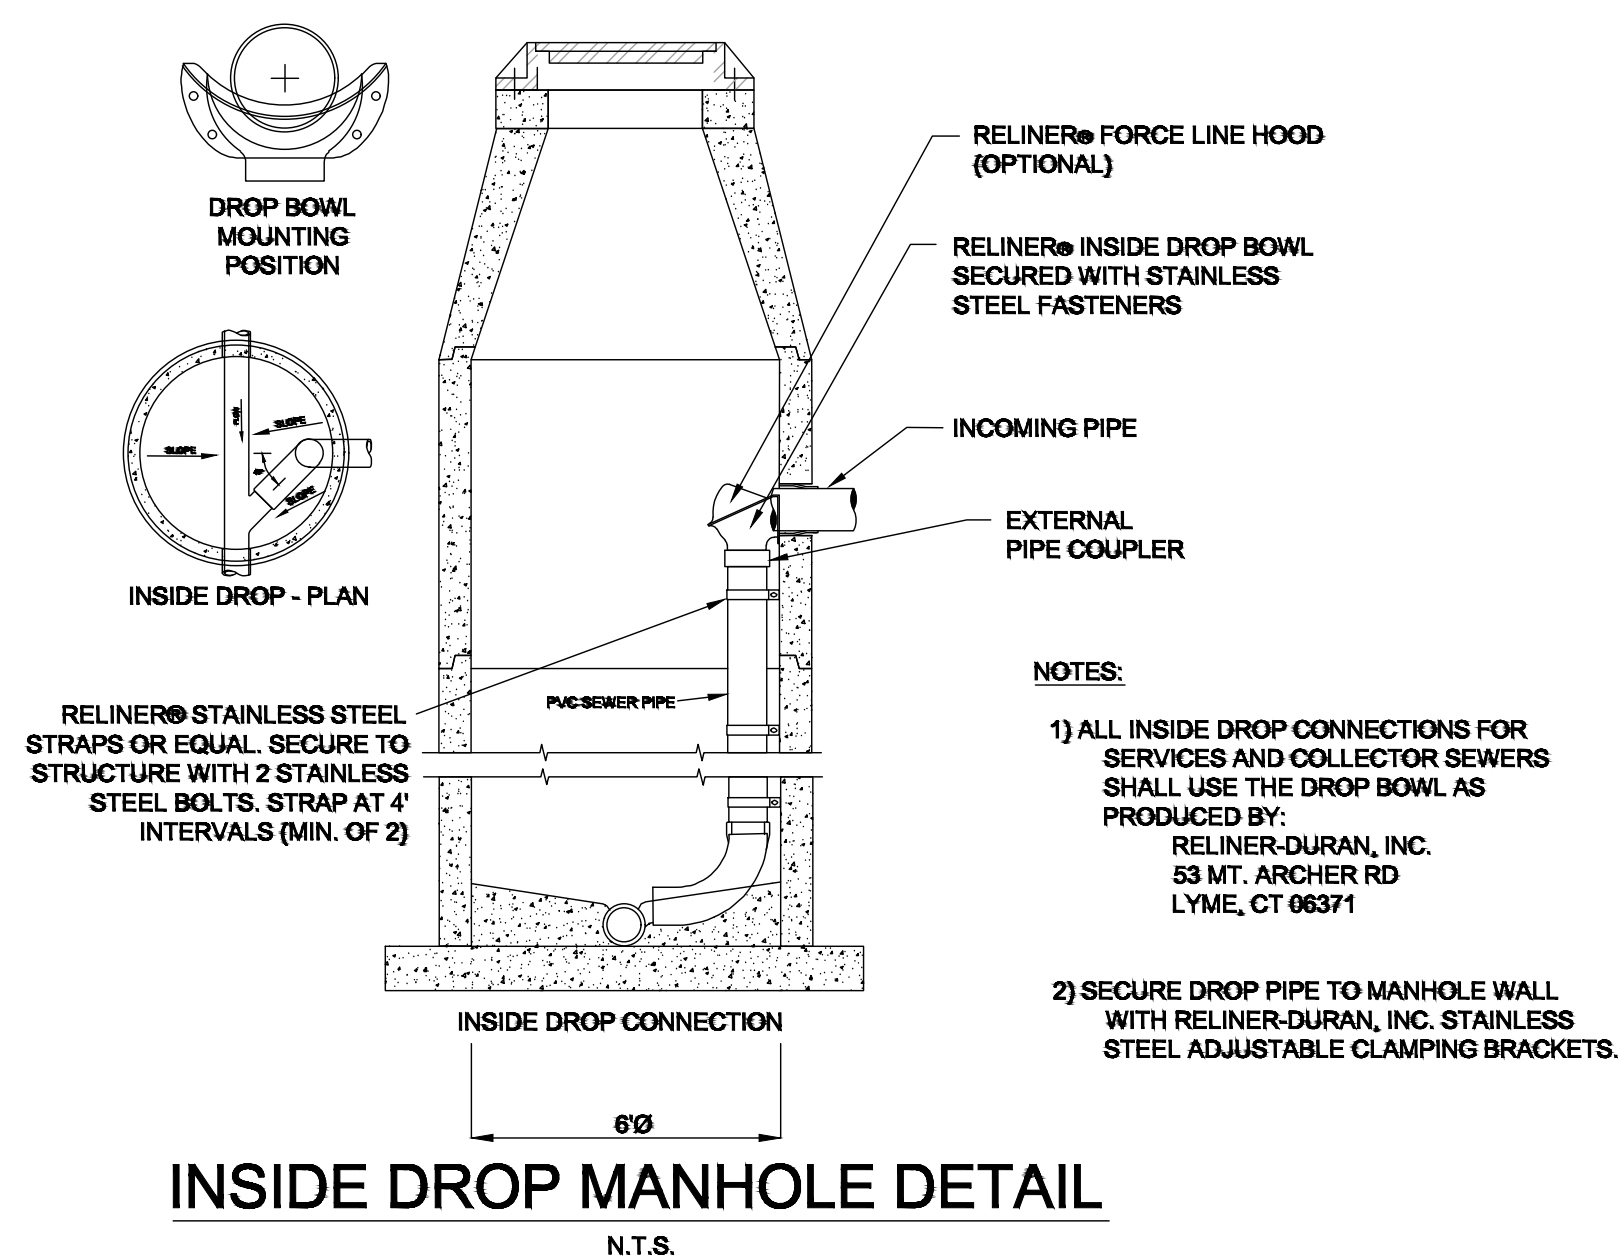


INSIDE DROP MANHOLE DETAIL

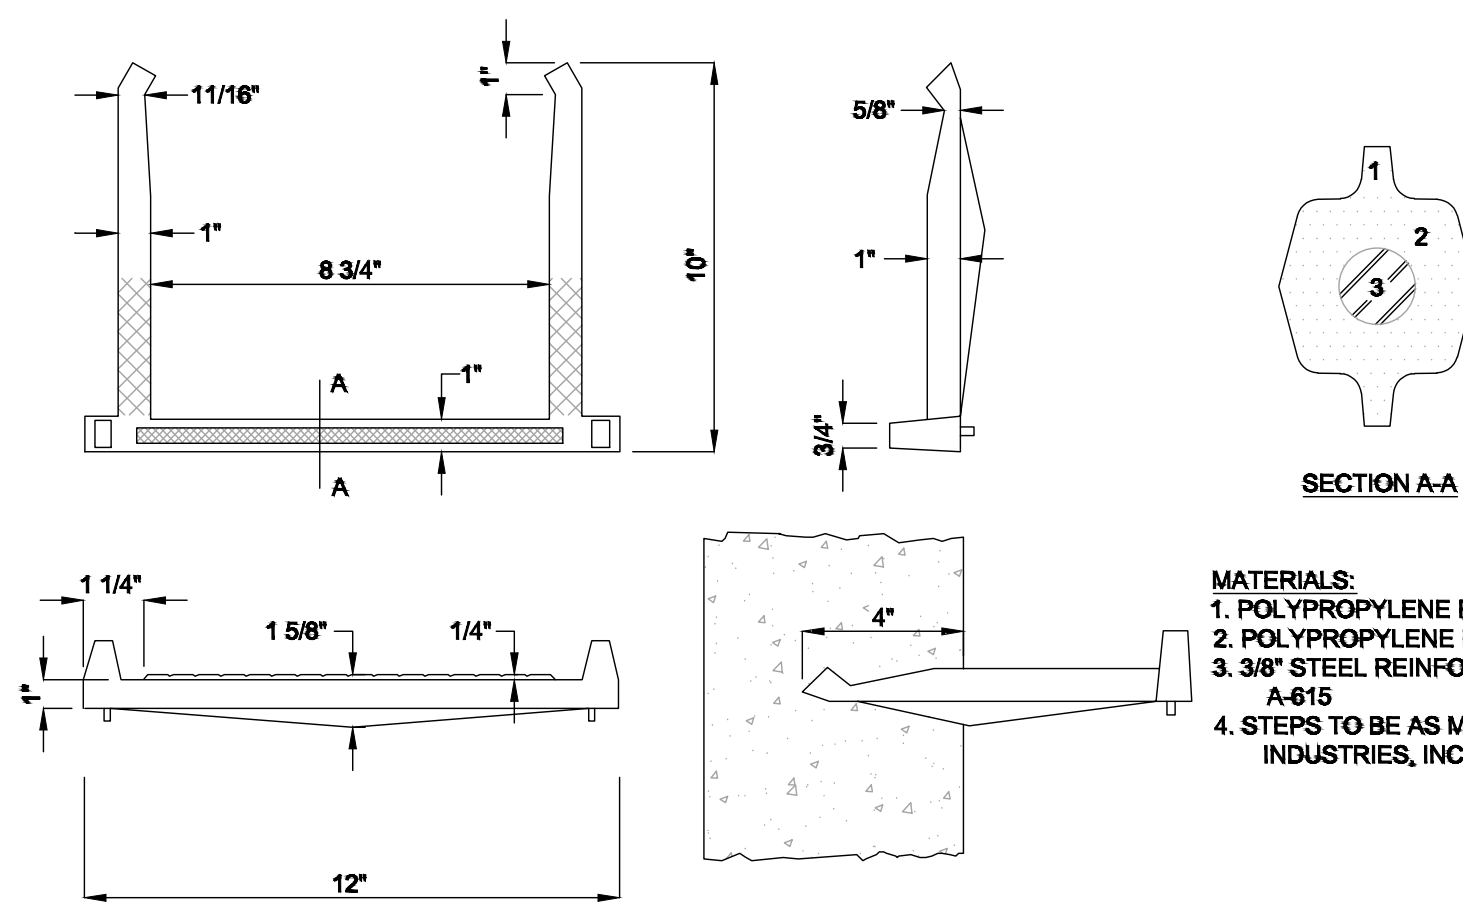


MANHOLE STEP - REINFORCED PLASTIC DETAIL

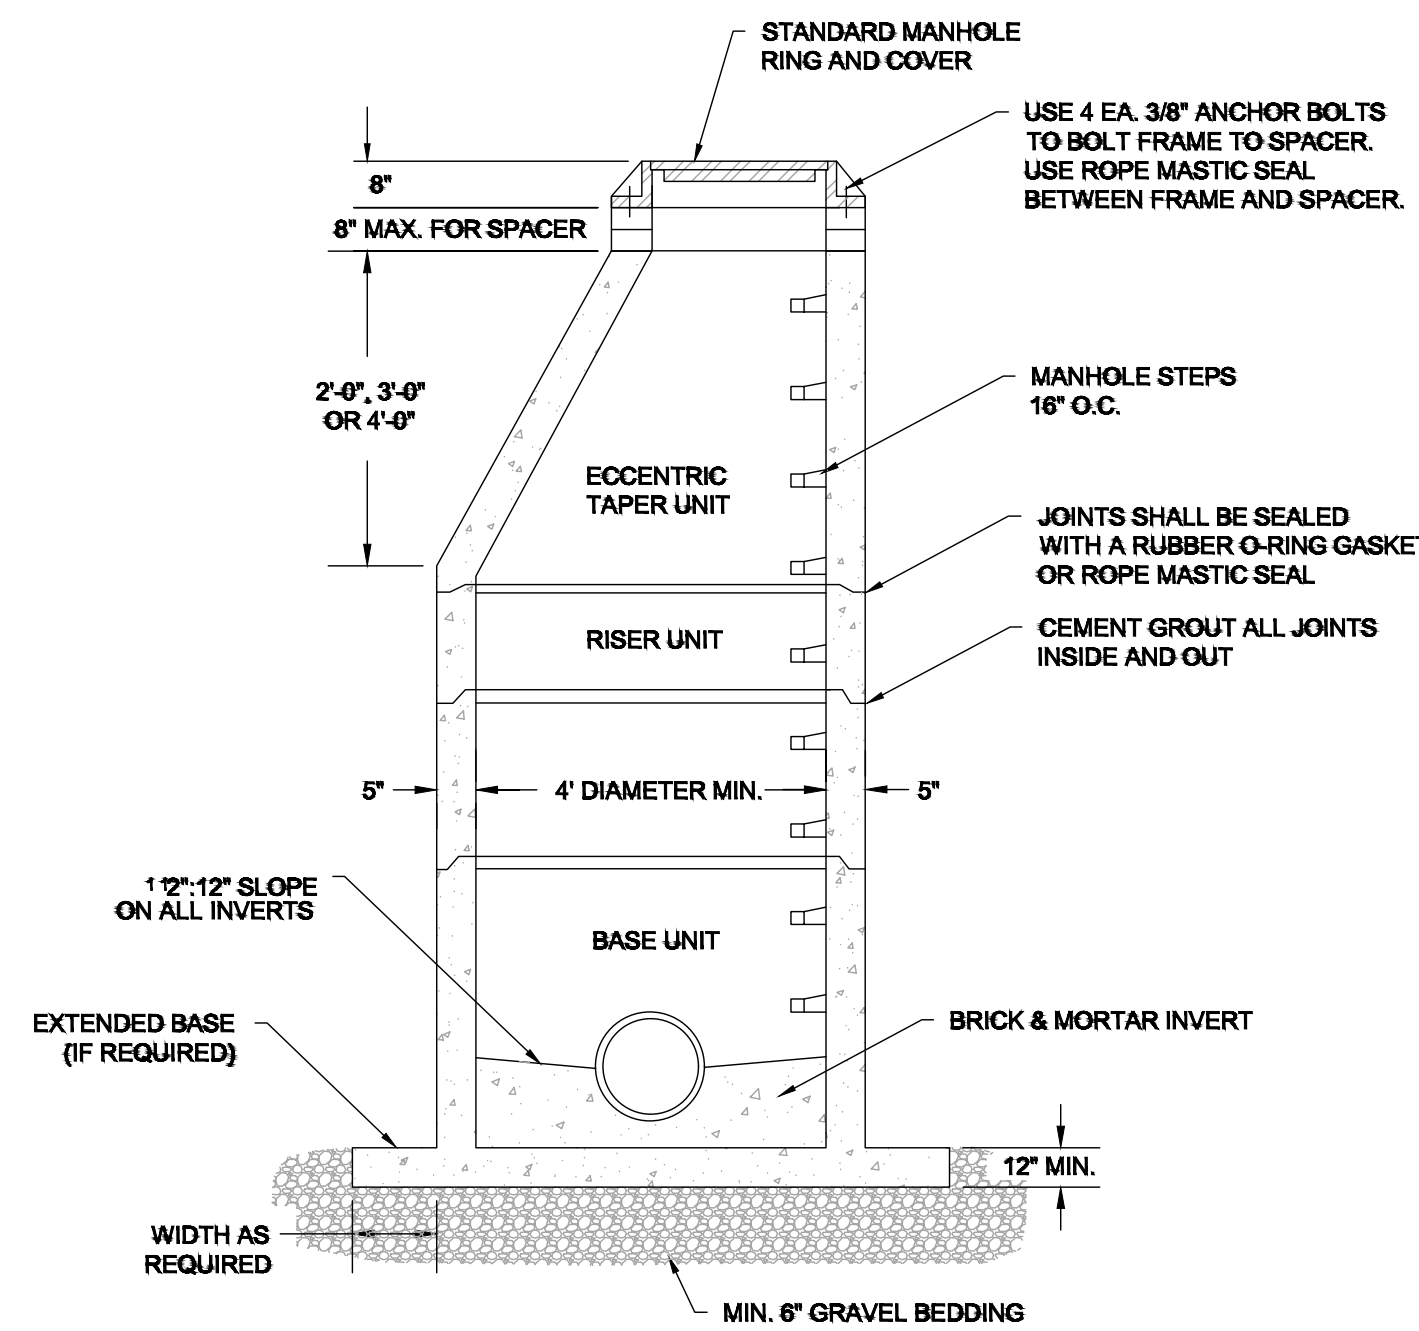

MANHOLE - STANDARD PRECAST CONCRETE DETAIL

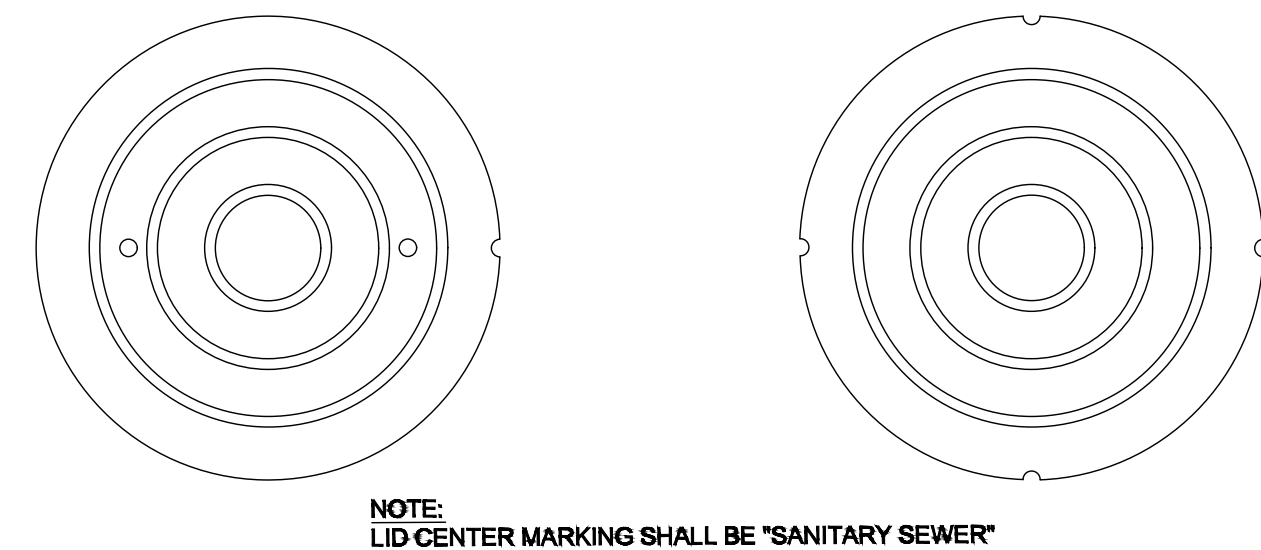


STANDARD COVER WATERTIGHT COVER

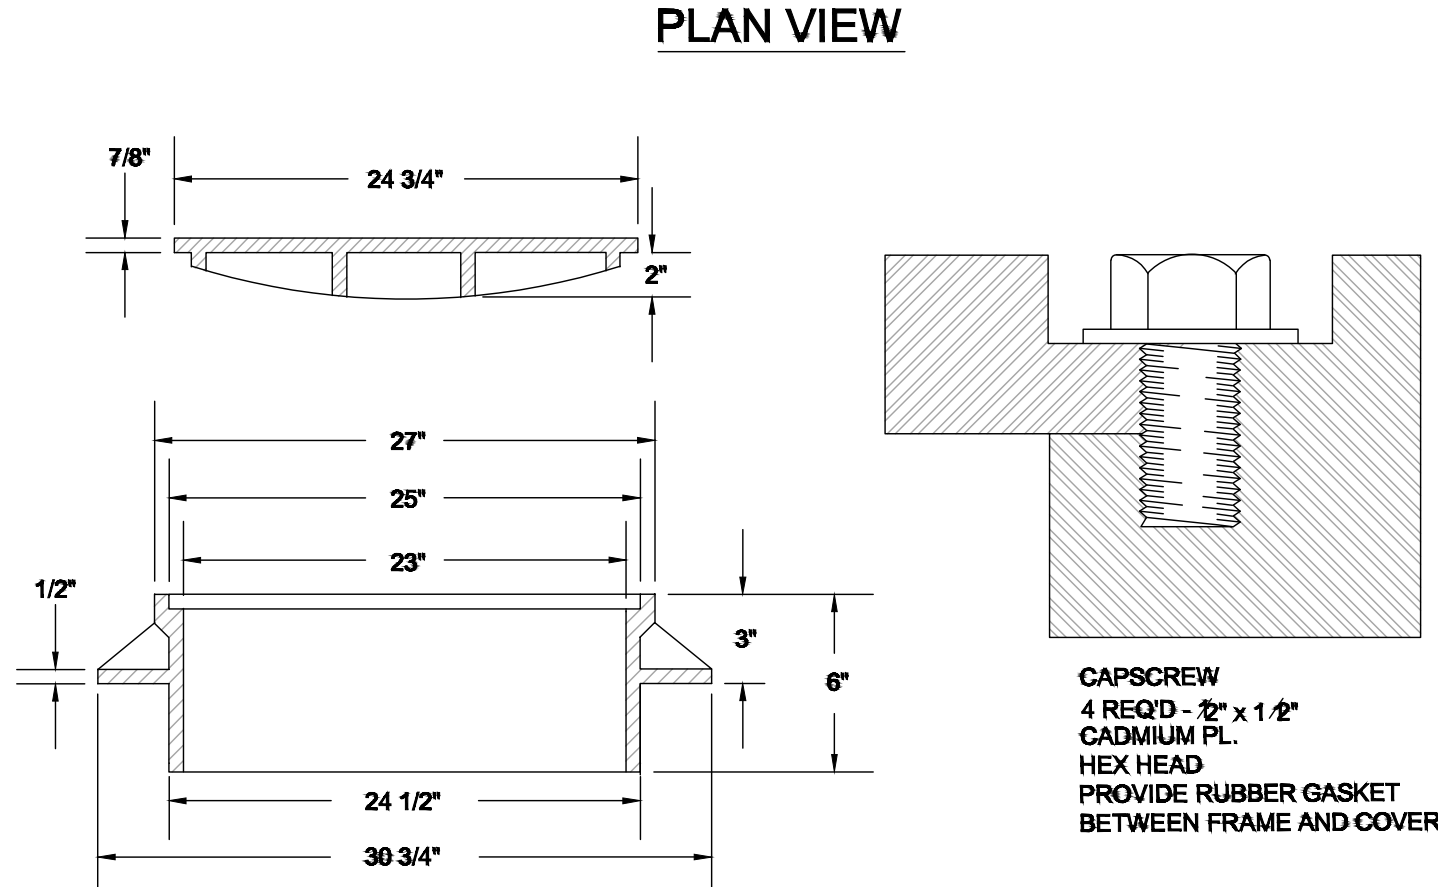

FRAME AND COVER SECTION WATERTIGHT FRAME AND COVER DETAIL



MANHOLE FRAME AND COVER DETAIL

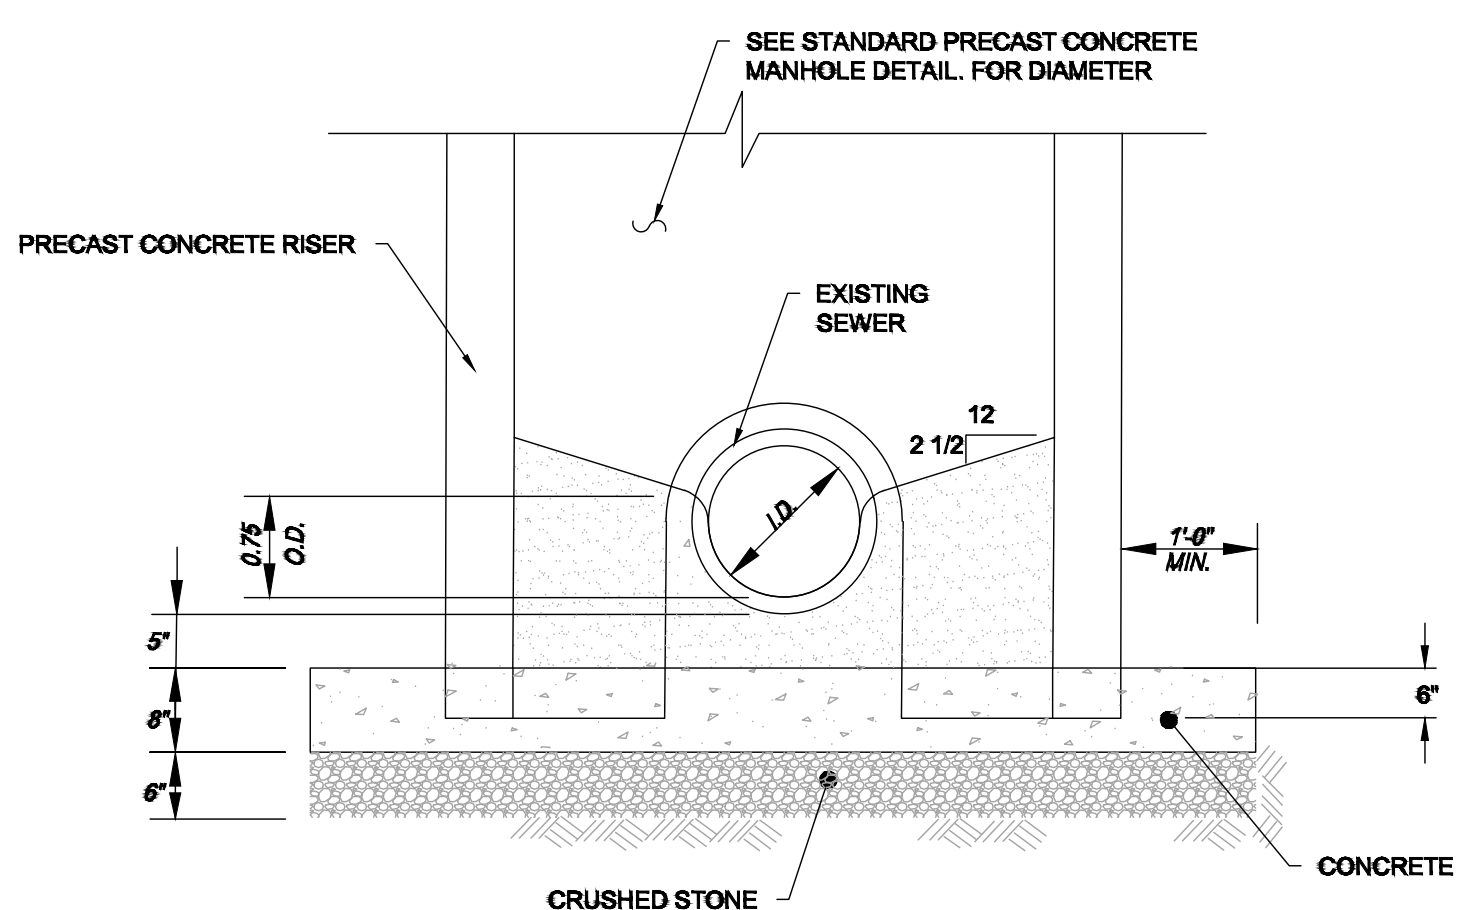

PRECAST DOGHOUSE MANHOLE OVER EXISTING SEWER DETAIL

DATE	REVISIONS & RECORDS OF ISSUE	BY	CH	AP	DRAWN	A. HARRIS		GAFFNEY BOARD OF PUBLIC WORKS	SEAL	PROJECT NAME	PROJECT NO.	SHEET NO.
					CHECKED			GAFFNEY, SC 29340		STANDARD DETAILS		OF
					APPROVED			864-488-8800		LIFT STATION AND MANHOLES		
					DATE	3-25-25						



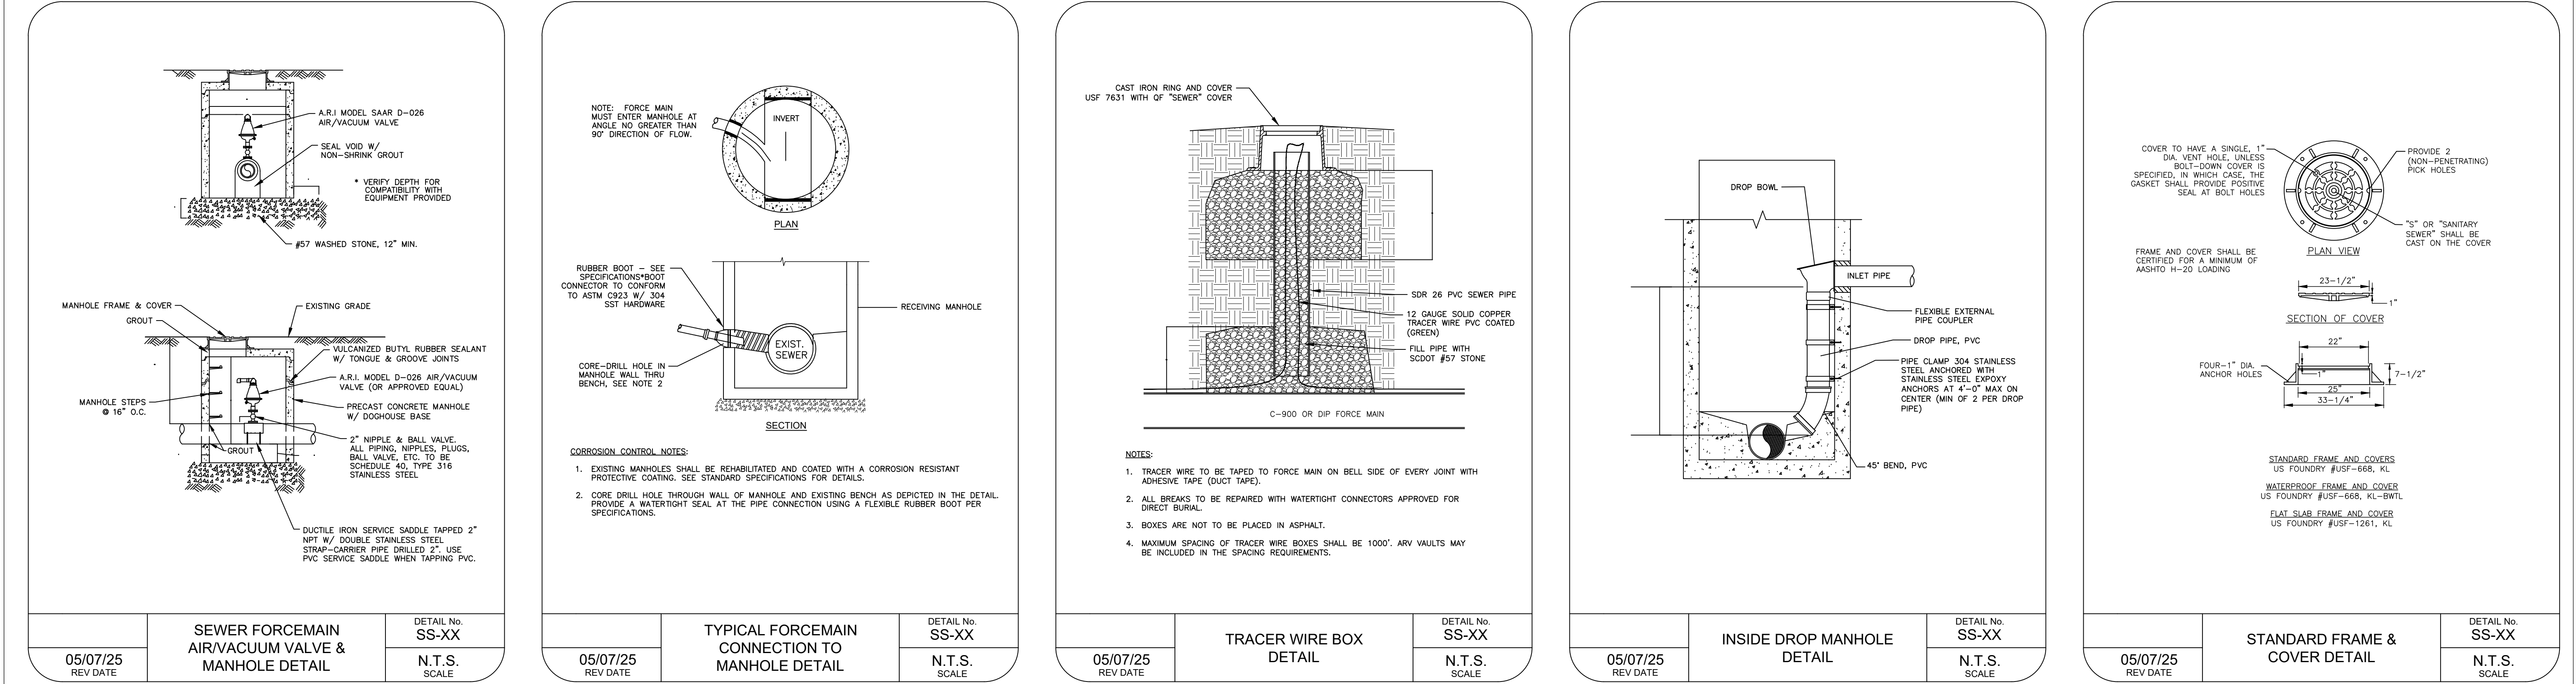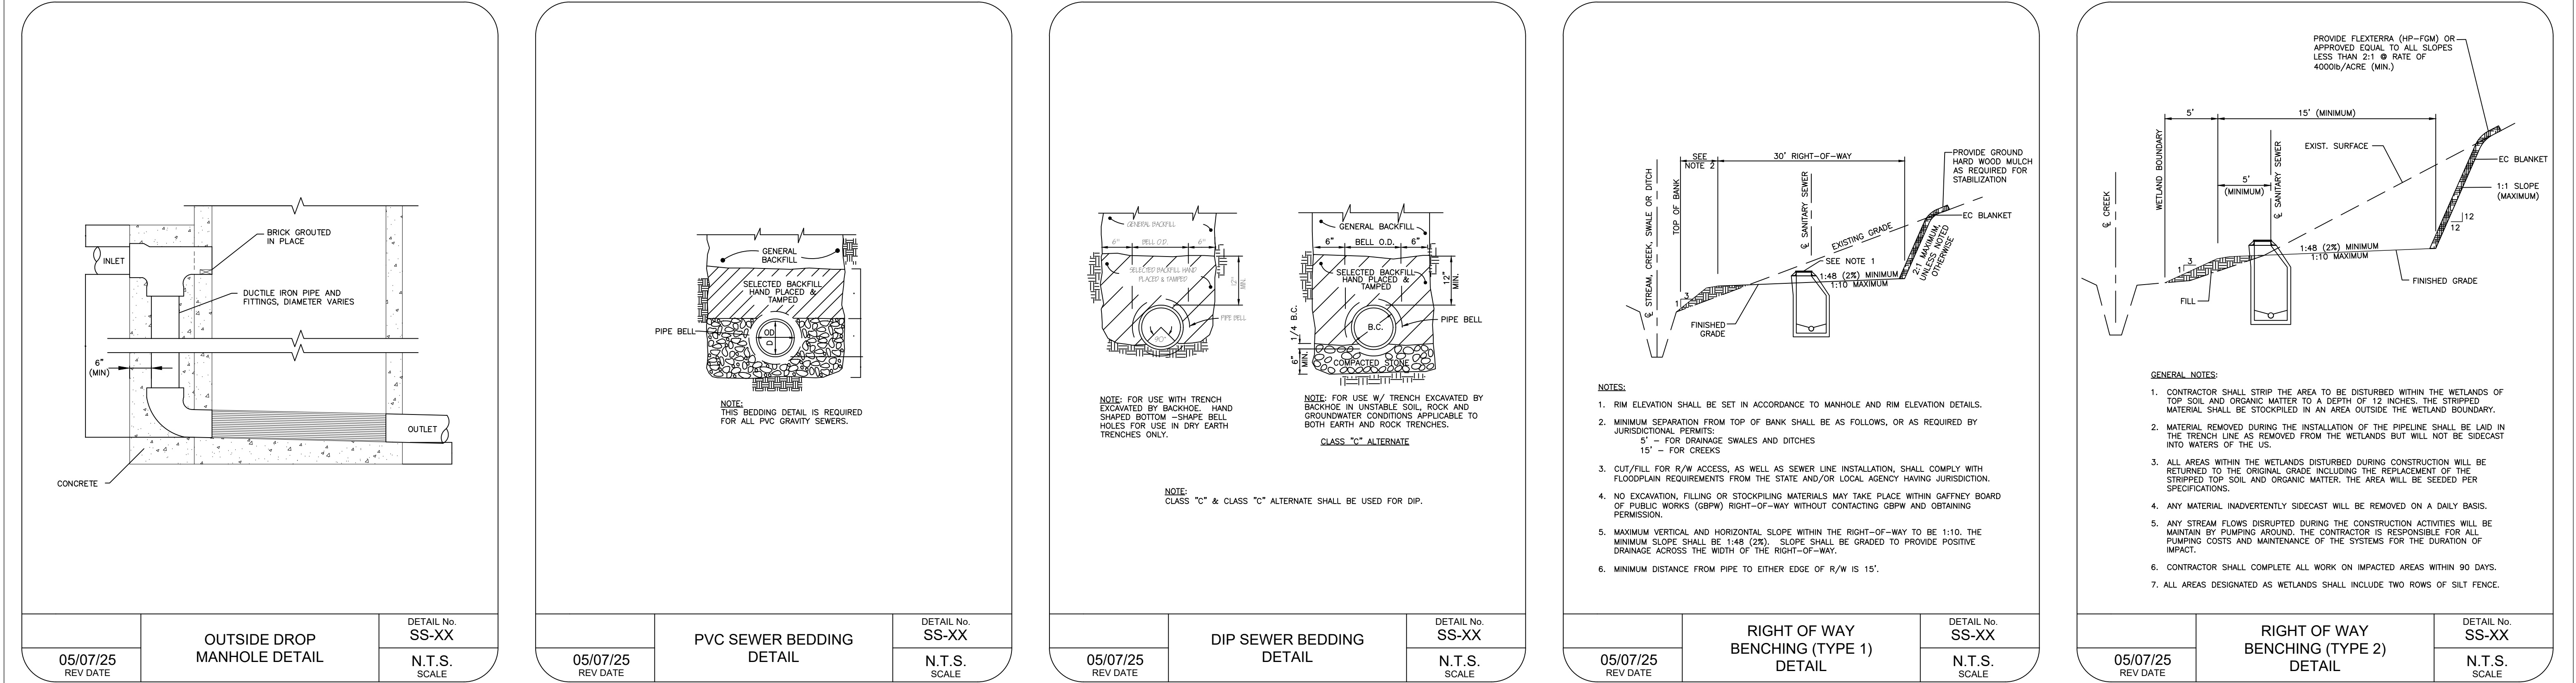

DATE	REVISIONS & RECORDS OF ISSUE	BY	CH	AP	DRAWN	A. HARRIS		GAFFNEY BOARD OF PUBLIC WORKS GAFFNEY, SC 29340 864-488-8800	SEAL	PROJECT NAME STANDARD SEWER DETAILS	PROJECT NO.	SHEET NO. OF
					CHECKED							
					APPROVED							
					DATE	3-25-25						