


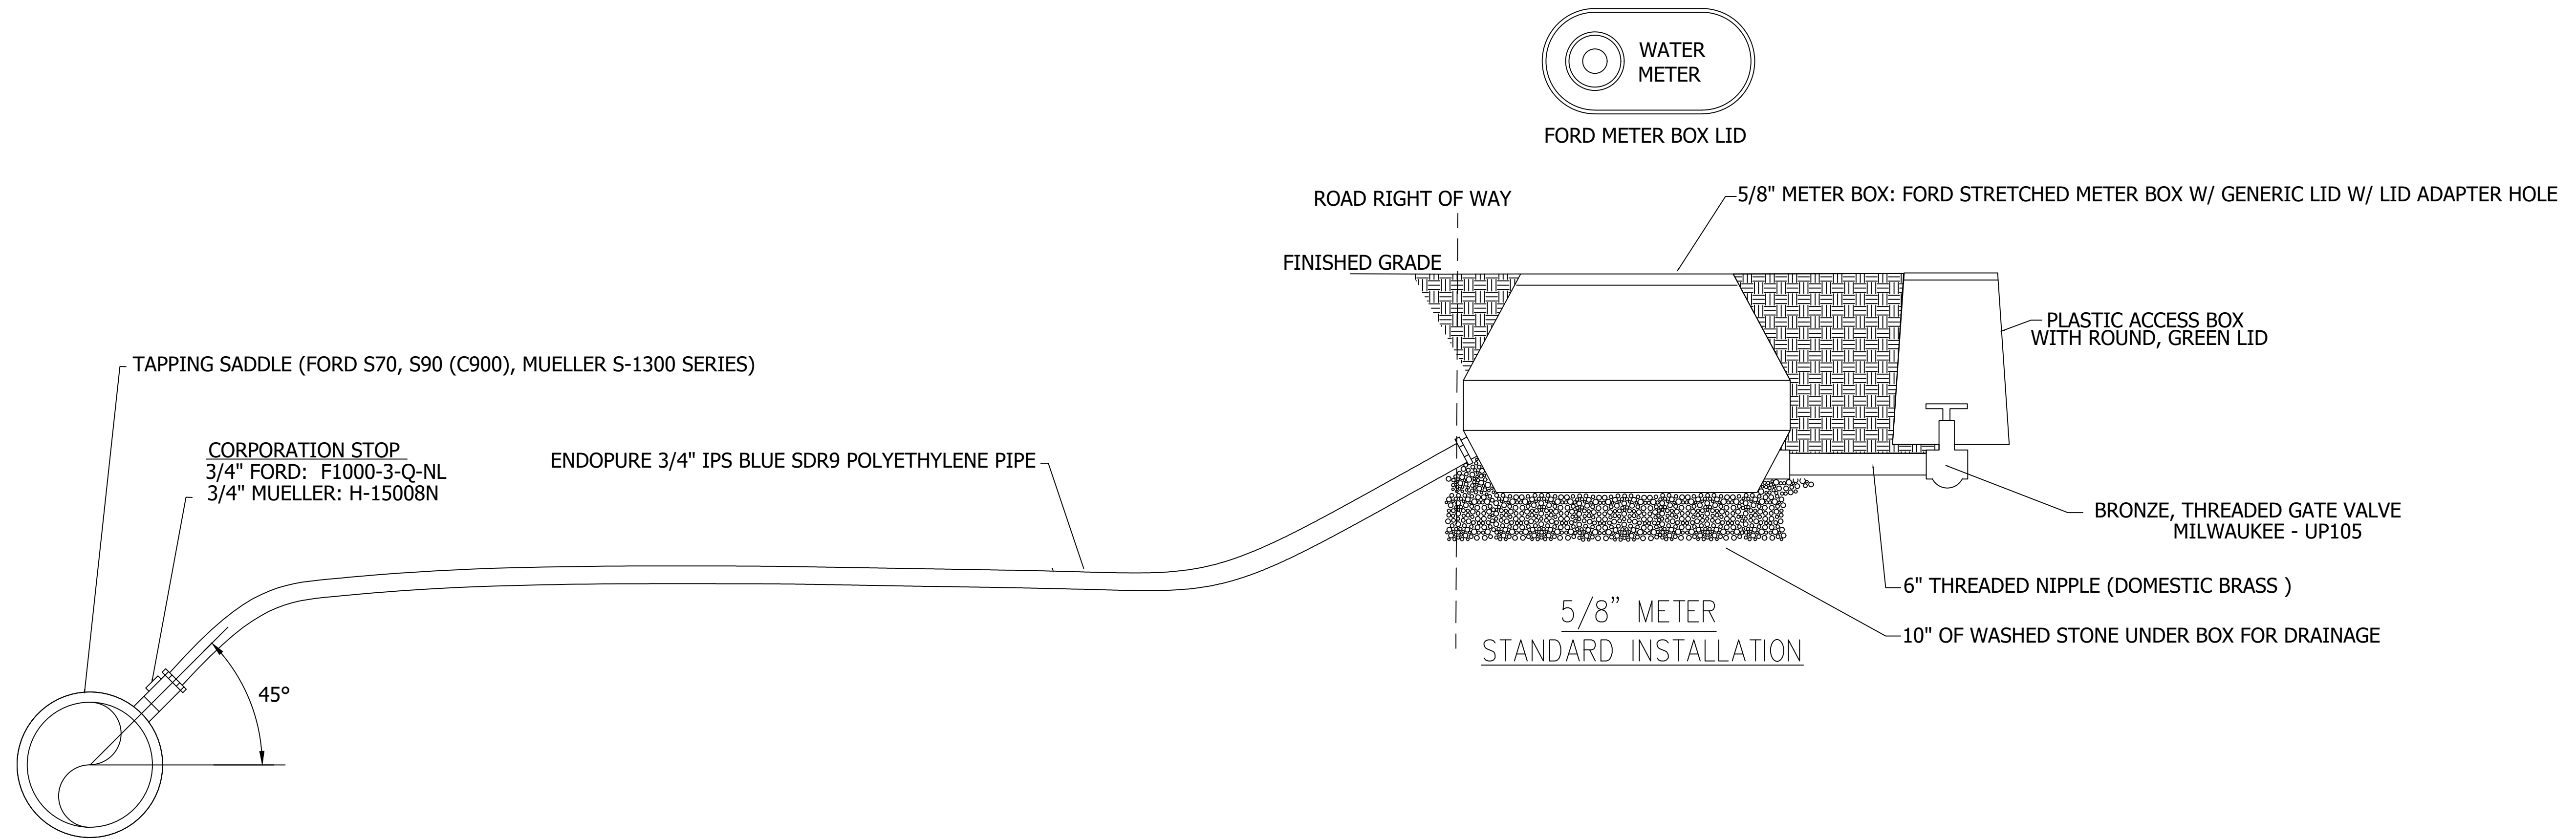

NOTES

1. METER MUST HAVE AT LEAST 10" OF #57 WASHED STONE UNDER BASE.
2. SERVICE LINE MUST HAVE 30" COVER UNDER ROADSIDE DITCH.
3. SERVICE LINE SHALL NOT BE PLACED UNDER DRIVEWAY.
4. METER BOXES SHALL BE SET PERPENDICULAR TO THE PROPERTY LINE.

DATE	REVISIONS & RECORDS OF ISSUE	BY	CH	AP	DRAWN A. HARRIS		GAFFNEY BOARD OF PUBLIC WORKS	SEAL	PROJECT NAME METER BOX DETAIL	PROJECT NO.	SHEET NO.
					CHECKED		GAFFNEY, SC 29340				
					APPROVED		864-488-8800				OF
					DATE 3-25-25						